



HEAT INDUSTRIAL

Installation Instructions for the MFH Duct



Contact Details

Sales Enquiries

EXHEAT Industrial Ltd
Threxton House
Threxton Road Industrial Estate
Watton, Thetford
Norfolk, IP25 6NG

Tel: +44 (0) 1953 886 210

Fax: +44 (0) 1953 883 853

Email: sales@exheat-industrial.com

Website: www.exheat-industrial.com

Technical Support

EXHEAT Industrial Ltd
Threxton House
Threxton Road Industrial Estate
Watton, Thetford
Norfolk, IP25 6NG

Tel: +44 (0) 1953 886 269

Fax: +44 (0) 1953 883 853

Email: support@exheat-industrial.com

Website: www.exheat-industrial.com

Duct and Bracket Installation Instructions

1 To fit the MFH Duct Bracket

- 1.1 The bracket may be fitted to the air inlet (Impeller side) or air outlet (Element Side)
- 1.2 To fit the duct bracket to the MFH Portable Fan Heater, start by removing the fan guard by removing the 8x fasteners with a large flat head screwdriver.
- 1.3 Insert the guard into the bracket and replace/fix with all 8x fasteners.

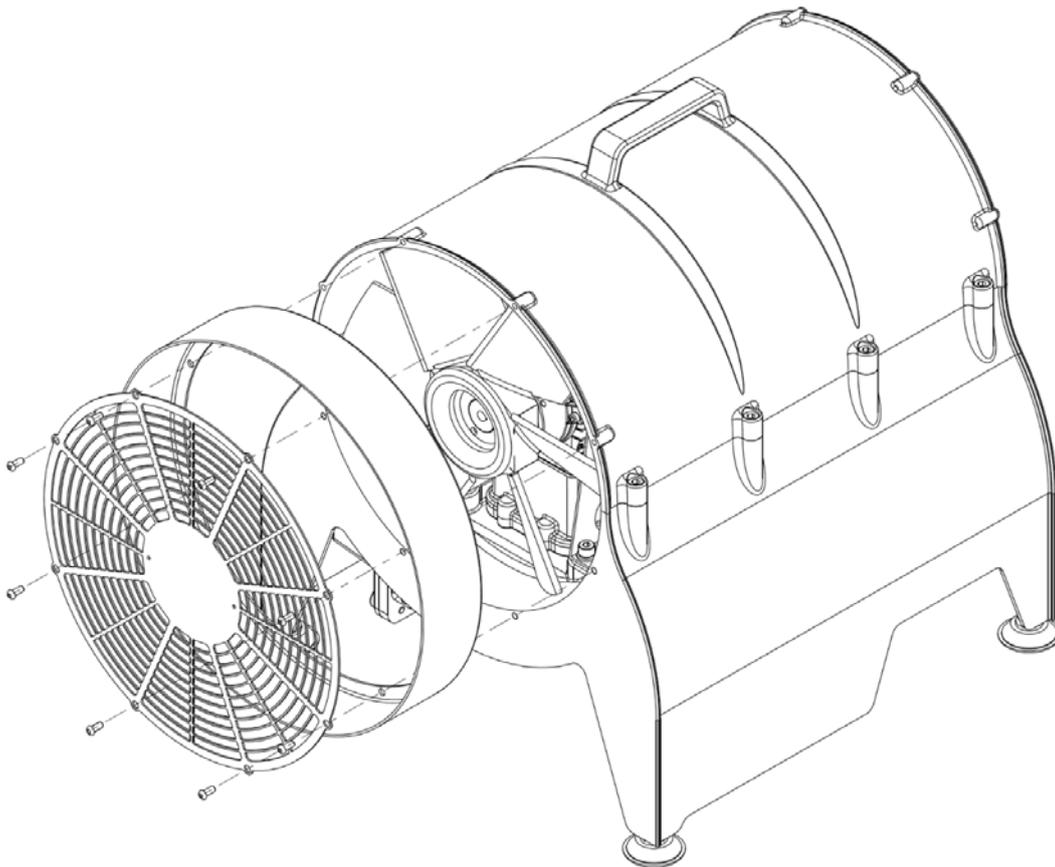


Fig. 1 Exploded diagram of fan guard and duct bracket

2 To fit the Ducting

- 2.1 Loosen the cuff strap to its extent and gently ease it over the tabs on the duct bracket.
- 2.2 With the heater held securely, pull the tail end of the strap so that it tightens around the bracket. The buckle will lock and prevent the strap from loosening.
- 2.3 Check that the duct is held securely.
- 2.4 Fit the earth ring crimp to the Earth Stud on the Duct bracket, and secure with a spring washer, flat washer and lock nut.

3 To fit multiple ducts.

- 3.1 Loosen the cuff strap to its extent and gently ease it over the wire ring of the already secured duct section.
- 3.2 Gently pull the tail of the strap until the strap itself can no longer slip over the wire ring.
- 3.3 Securely connect the earth wires of each of the ducts to one another to ensure continuity.

4 To fit a Wye

- 4.1 Loosen the cuff strap to its full extent and gently ease it over the duct bracket or wire ring of the already secured duct section, whichever is applicable.
- 4.2 Complete as per Instruction 2 when fitting to the bracket, or Instruction 3 when fitting to the wire ring of another duct.



www.exheat-industrial.com

© Copyright EXHEAT® Industrial Ltd

First Edition (October 2017)

Author: J. Brown

MFH-DUCT_English

Refer to EXHEAT Industrial Ltd website for latest edition. (www.exheat-industrial.com/product)